



Technical data

operating voltage 24V AC/DC±10 %
 power consumption FGO <8 mA
 power consumption FGS <15 mA
 weight approx. 75g
 contacting connecting terminals on the housing

Type FGO 2.K/5

measuring range (0...10 V) 50...100%rh
 accuracy (MR 50...95%rh , at 23°C) ±2%rh
 output signal 0...10V
 response time (at calm air) < 20 s

Type FGS 02.K/5

break point (factory setting)
 „off“ (contact „open“) ≥96 ± 2%rh
 „on“ „off“-4%rh ±1%rh
 output floating contact
 voltage max. 48V
 switching current max. 0.5A
 switching power max. 10W

Type FGS 02.K/6

break point (factory setting)
 „on“ (contact „closed“) ≥90 ± 2%rh
 „off“ „on“-4%rh ±1%rh
 output floating contact
 voltage max. 48V
 switching current max. 0.5A
 switching power max. 10W

Temperature application range FGO -20...+80°C
 FGS 0...+70°C

Directive about electromagnetic compatibility **2004/108/EG**
 DIN EN 61326-1 issue 10/06
 DIN EN 61326-2-3 issue 05/07

Humidity sensors for condensation control

- analogue output signal Type FGO 2.K/5
- switching output (break contact) Type FGS 02.K/5
- switching output (break contact) Type FGS 02.K/6

Description

Dew-point control sensors are mounted on cooling water pipes or on cooled surfaces and are used to monitor if the temperature drops below the dew-point.

They measure the relative humidity directly on the surface of the cooled part of the equipment and can, therefore, be used

- to influence cooling power
- to switch cooling systems on or off
- to signal the point at which the temperature drops below the dew-point.

This means that cooling ceilings, for example, can be operated with perfect results, even at critical climatic values, without condensation starting to form.

User instructions

The sensors are to be mounted in the place where condensation is most likely to form, on the polished metal pipe using cable binders and on a smooth surface which must be clear of grease and be dry using the **ZA 30-type mounting kit** which is available as an accessory.

Ensure that there is good thermal contact between the pipe or the surface and the humidity sensor.

The installation position is to be selected in such a way that a representative measurement of the air humidity will be given, i.e. the ambient air must be able to reach the measuring element within the casing without obstacles. The condensation controller should be exposed to the flow of air.

The sensors come ready-calibrated and, consequently, do not need to be adjusted on-site.

Please consult the **application instructions for the sensing elements** (product info sheet no. A 1) or check with the manufacturer for further information which you need to bear in mind when using humidity sensors with capacitive sensing elements.


Type Survey

Type	FGS02.K/5	FGS02.K/6	FGO2.K/5
Order no.	42FGS02.K/5	42FGS02.K/6	45FGO2.K/5

Assembly drawing

Mounted on:


...pipes

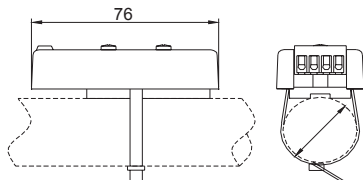

The electrical connection must only be carried out by properly qualified personnel.

...smooth surfaces

(Mounting-Kit ZA30)



ATTENTION! Sensors FG02.K/5 have no galvanical separation between output and operating voltage at the negative pole. Please pay attention to this fact when connecting an AC operating voltage.

Pin assignment

Supply	Clamp	FGS02.K/5	FGS02.K/6	FGO2.K/5
24V AC/DC ± 10%	1	- (~)	- (~)	- (~)
	2	+ (~)	+ (~)	+ (~)
Output		contact	contact	analogue
		3 4	break contact	make contact
Break point		96%rh	90%rh	50...100%rh